



# Engineering Specification

## **WC-75-H-C-\*D-\*\***


High Temperature Cascade Water to Water Heat Pump  
60 Hz



Maritime Geothermal Ltd.  
P.O. Box 2555, 170 Plantation Road  
Petitcodiac, NB E4Z 6H4  
(506) 756-8135

info@nordicghp.com  
www.nordicghp.com  
**002247SPC-02**

# Model Nomenclature

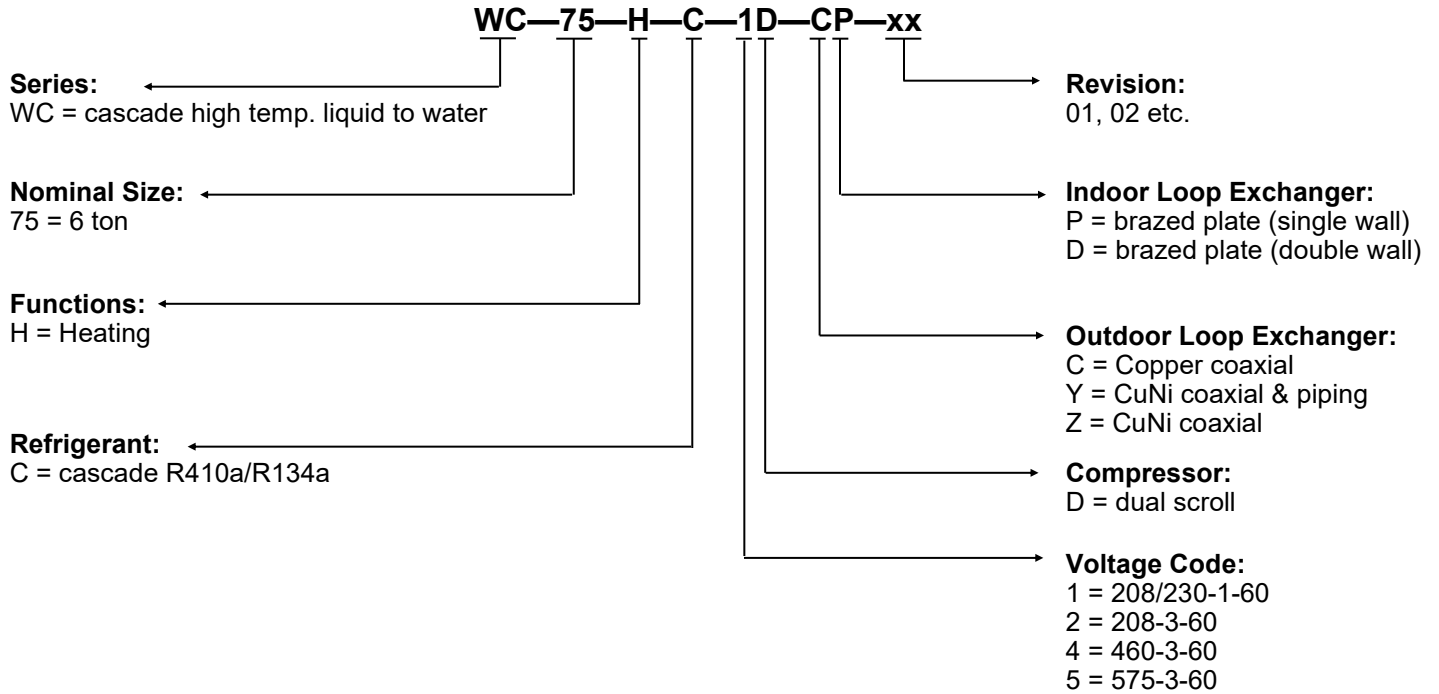

APPLICATION TABLE										
MODEL SIZE	FUNCTION	REFRIGERANT	VOLTAGE	COMPRESSOR	OUTDOOR COIL	INDOOR COIL	REVISIONS			
WC-75	H	C	1 2 4 5	D	C Y Z	P D	04			
This manual applies only to the models and revisions listed in this table.										

Maritime Geothermal Ltd. has a continuous improvement policy and reserves the right to modify specification data at any time without prior notice .

# Design Features

---



- Two refrigerant circuits, with each doing half the temperature lift; results in a true geothermal unit that can heat water to 160° F / 71° C on the indoor loop
- Lower-temp R410a and higher-temp R134a circuits exchange heat through an intermediate brazed plate heat exchanger
- Two Copeland scroll compressors with start capacitor kits on single phase models
- Outdoor loop: coaxial heat exchanger, with CuNi option available
- Indoor loop: brazed plate condenser, with double wall option available for direct heating of domestic hot water
- 18/20ga satin galvanized cabinet with reinforcing channel stiffeners, powder coat finish
- Acoustically insulated cabinet (1" and 1/2" thick)
- Completely insulated heat exchangers and piping
- Four removable access panels
- Refrigeration service ports located inside unit (1/4" Schrader)
- Oversized electrical box for clarity and easy service
- Component layout allows easy access for service
- 1" Brass FPT fittings for Outdoor Loop and Indoor Loop connections
- Dual grommet mounting system for compressors reduces noise and vibration
- Suction line accumulators
- Liquid line filter-dryers
- Liquid line sight glasses
- Electronic Expansion Valves (EEVs)
- Refrigerant high and low pressure sensors
- Suction line temperature sensors
- Manual reset high pressure controls
- Temperature sensors on all 4 water lines
- Control transformer with resettable breaker or fuse protection
- Advanced control board with BACNet interface for remote operation and data access including all sensor data and alarm conditions, PWM outputs (or 0-10VDC), configurable analog inputs (0-5VDC or 4-20mA) with onboard 5VDC, 12VDC and 24VDC power supplies
- USB port for complete data access including real-time charting, data logging, and diagnostic functionality with manual override operation
- 2 x 16 LCD display for control and data access; unit may be configured for standalone operation with outdoor reset functionality (requires outdoor temperature sensor accessory)
- Random start on power up (0-2 minutes)
- TUV listed for electrical certification

## Available Accessories

---

- Hydronic buffer tank with 12, 15, or 20kW of electric backup elements
- Circulator pump module with loop / unit isolation valves (230VAC) for ground loop applications
- Barbed P/T port adapters for heat pump
- Anti-vibration pad for under unit
- Compressor sound jackets
- Secure Start modules
- 1" water valve (slow closing or solenoid) & wiring harness for open loop applications
- CuNi heat exchanger option for outdoor loop
- Double wall condenser option for direct domestic hot water heating
- Outdoor temperature sensor with enclosure, for outdoor reset functionality
- Compressor current sensors

# Design Features

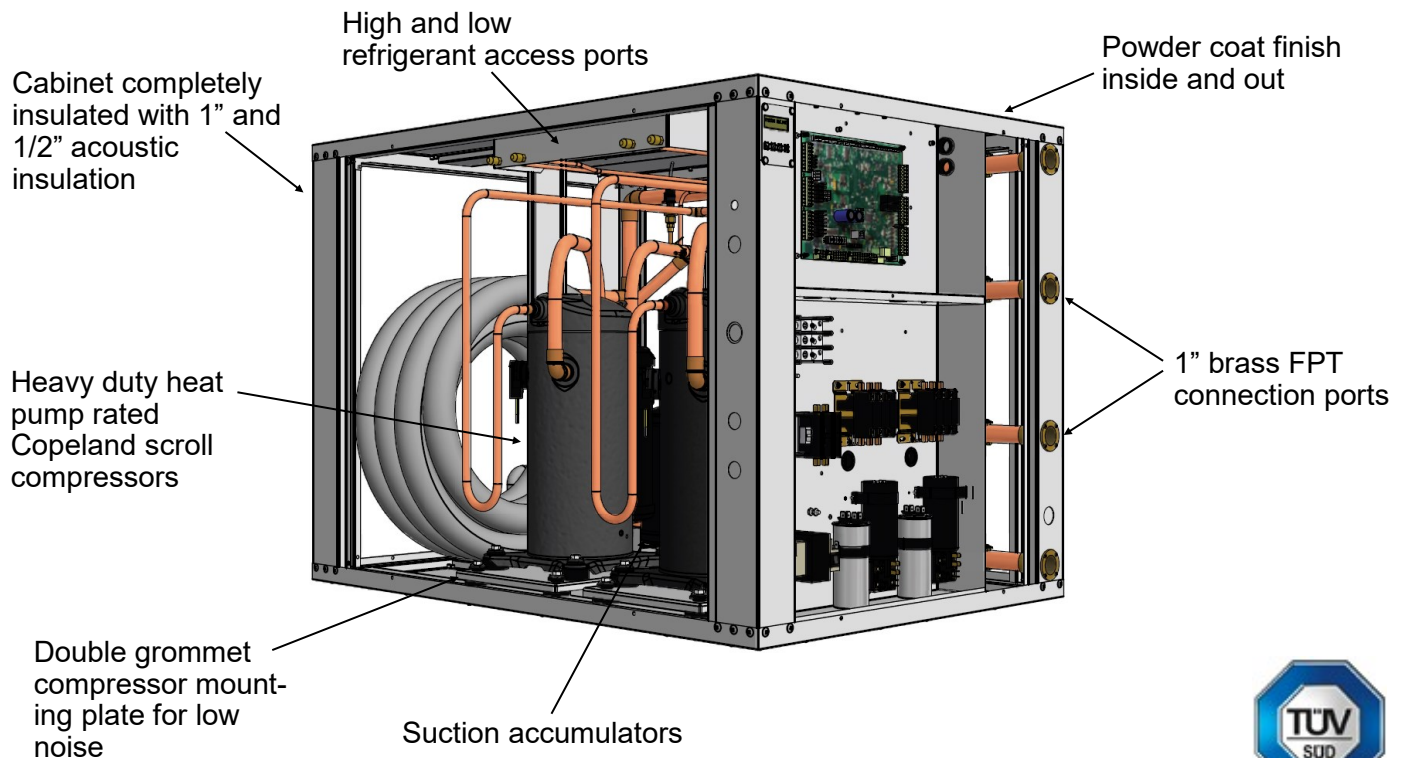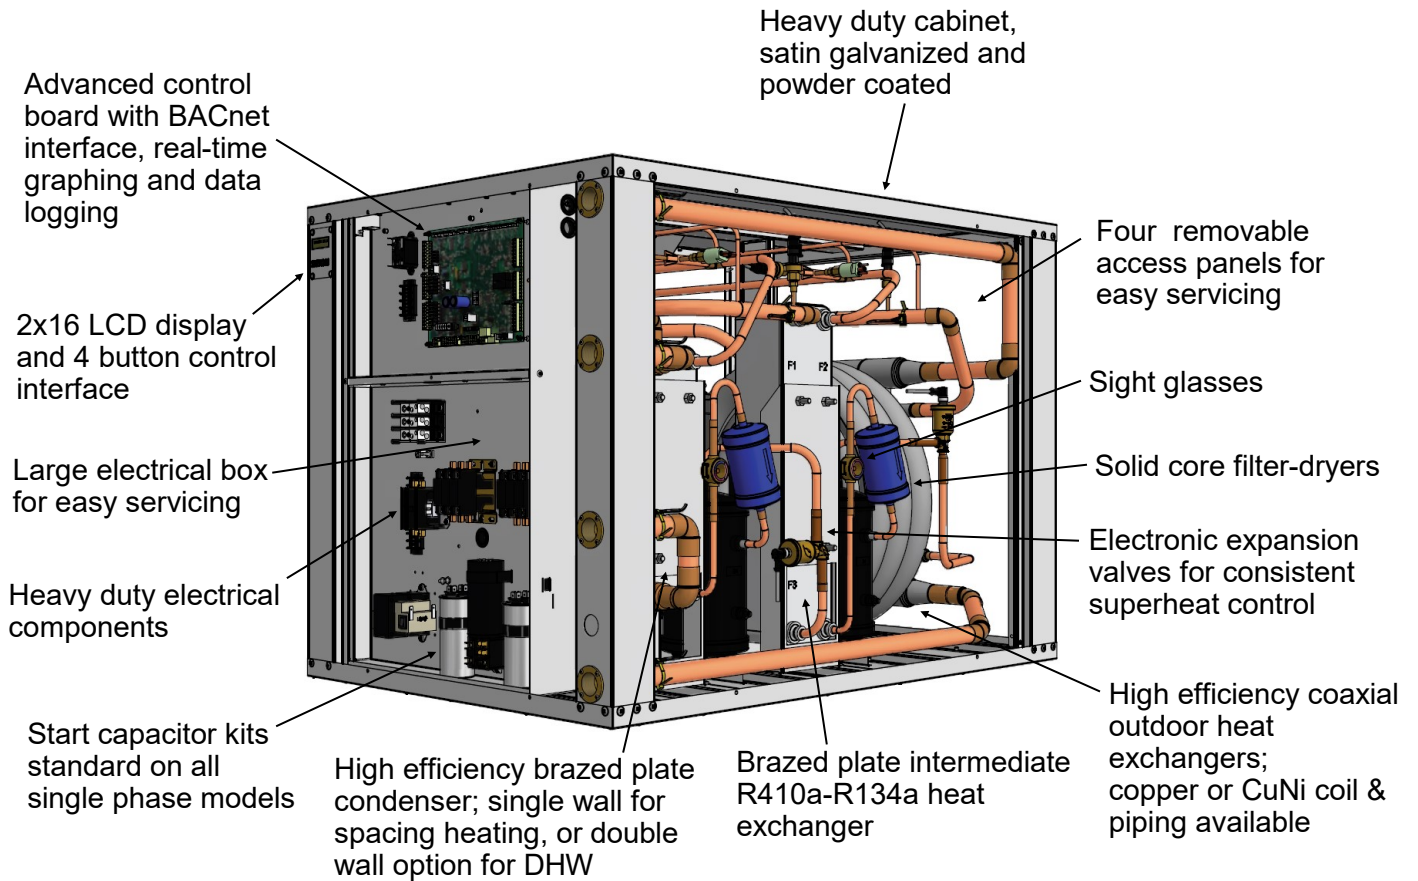



# Specifications

Electrical Specifications												
Code	Power Supply			Compressor (R410a)		Compressor (R134a)		Circulators	FLA	MCA	Max. Breaker	Min. Wire
	V-ø-Hz	MIN	MAX	RLA	LRA	RLA	LRA	Max A	Amps	Amps	Amps	ga
1	208/230-1-60	187	253	26.3	134	23.7	144	7.0	50.2	63.8	80	#6-2*
2	208-3-60	187	229	15.6	110	18.6	128	7.0	34.4	46.1	60	#6-3*
4	460-3-60	414	506	7.8	52	9.0	63	-	17.0	19.3	30	#10-3
5	575-3-60	518	632	5.8	39	6.6	49	-	12.6	14.3	20	#12-3

\*one additional conductor required if connecting 115VAC circulators to unit.

Refrigerant Charge				
MODEL	R410a		R134a	
	lb.	kg	lb.	kg
WC-75	7.0	3.2	7.0	3.2

Refrigerant charge is subject to revision; actual charge is indicated on the unit nameplate.  
POE oil capacity is marked on the compressor label.

Shipping Information				
MODEL	WEIGHT lb. (kg)	DIMENSIONS in (cm)		
		L	W	H
WC-75	560 (255)	46 (117)	36 (91)	35 (89)

WC-Series Operating Temperature Limits					
Loop	Mode	Parameter	(°F)	(°C)	Note
Indoor	Heating	Minimum EWT	70 - 110	21 - 43	Use formula (Outdoor ELT + 20°F) or (Outdoor ELT + 11°C).
	Heating	Maximum LWT	160	71	
Outdoor (Water)	Heating	Minimum ELT	39	4	
	Heating	Maximum ELT	70	21	Reduce flow above this temp. to limit refrigerant suction pressure.
Outdoor (Antifreeze)	Heating	Minimum ELT	23	-5	Adequate antifreeze protection required.
	Heating	Maximum ELT	70	21	Reduce flow above this temp. to limit refrigerant suction pressure.

Values in this table are for rated liquid flow values.  
EWT - Entering Water Temp., LWT - Leaving Water Temp., ELT - Entering Liquid Temp., LLT - Leaving Liquid Temp.

Pressure Drop Data			INDOOR Single wall option (water 140°F)		INDOOR Double wall option (water 140°F)		OUTDOOR (water 50°F)		OUTDOOR (15% methanol 32°F)		OUTDOOR (35% propylene glycol 32°F)	
	gpm	L/s	psi	kPa	psi	kPa	psi	kPa	psi	kPa	psi	kPa
WC-75	8	0.50	0.6	4.3	0.5	3.4	1.3	9.0	1.3	9.0	1.7	12
	9	0.57	0.8	5.4	0.7	4.8	1.6	11	1.6	11	2.1	14
	10	0.63	1.0	6.5	0.9	6.2	1.9	13	2.1	14	2.8	19
	11	0.69	1.1	7.6	1.0	6.9	2.3	16	2.4	17	3.2	22
	12	0.76	1.3	8.9	1.2	8.3	2.6	18	2.9	20	3.8	26
	13	0.82	1.5	11	1.3	9.0	3.0	21	3.3	23	4.3	30
	14	0.88	1.8	12	1.5	10	3.2	22	3.7	26	4.9	33
	15	0.95	2.0	14	1.7	12	3.5	24	4.1	28	5.4	37
	16	1.01	2.3	16	2.0	14	4.0	28	4.7	32	6.2	43
	17	1.07	2.5	17	2.3	16	4.4	30	5.2	36	6.8	47

# Performance Tables

WC-75-H-C-\*D-\*\* 60 Hz, ZP54K5E-PFV / ZR61KCE-PFV


	OUTDOOR LOOP (35% Propylene Glycol)						ELECTRICAL	INDOOR LOOP (Water)						
	ELT (°F)	Evap. Temp.	Flow (gpm)	LLT (°F)	Delta T (°F)	Heat Abs. (Btu/hr)	Input Power (W)	EWT (°F)	Cond. Temp.	Flow (gpm)	LWT (°F)	Delta T (°F)	Heating (Btu/hr)	COP <sub>H</sub>
HEATING	25	14	16	21	4.4	33,200	7,030	113	122	16	120	7.2	57,200	2.38
	30	18	16	25	4.9	36,000	7,010	113	123	16		7.4	59,900	2.50
	35	23	16	30	5.3	39,400	7,540	112	125	16		8.2	65,100	2.53
	40	27	16	34	5.8	42,200	7,470	112	126	16		8.4	67,700	2.66
	45	32	16	39	5.6	45,300	7,960	111	127	16		9.2	72,500	2.67
	50	36	16	44	6.0	47,700	7,820	111	128	16		9.2	74,400	2.79
	25	15	16	21	4.5	33,800	8,100	132	143	16	140	7.8	61,400	2.22
	30	19	16	25	4.9	36,000	8,030	132	144	16		7.9	63,400	2.31
	35	24	16	30	5.2	38,700	8,560	131	145	16		8.6	67,900	2.32
	40	28	16	34	5.6	40,700	8,500	131	145	16		8.6	69,700	2.40
	45	32	16	40	5.4	43,600	9,090	131	146	16		9.4	74,600	2.41
	50	36	16	44	5.8	46,000	8,960	131	148	16		9.5	76,600	2.50
	25	15	16	21	4.4	33,100	9,470	152	165	16	160	8.3	65,400	2.02
	30	19	16	25	4.8	35,500	9,360	152	166	16		8.4	67,400	2.11
	35	24	16	30	5.2	38,400	9,910	151	167	16		9.1	72,200	2.14
	40	29	16	35	5.5	40,400	9,860	151	167	16		9.2	74,100	2.20
	45	33	16	40	5.4	43,500	10,490	150	168	16		10.0	79,300	2.21
	50	36	16	44	5.8	45,800	10,390	150	169	16		10.1	81,300	2.29

## METRIC

	OUTDOOR LOOP (35% Propylene Glycol)						ELECTRICAL	INDOOR LOOP (Water)						
	ELT (°C)	Evap. Temp.	Flow (L/s)	LLT (°C)	Delta T (°C)	Heat Abs. (W)	Input Power (W)	EWT (°C)	Cond. Temp.	Flow (L/s)	LWT (°C)	Delta T (°C)	Heating (W)	COP <sub>H</sub>
HEATING (METRIC)	-3.9	-9.9	1.0	-6.3	2.5	9,700	7,030	44.9	50.2	1.0	49	4.0	16,700	2.38
	-1.1	-7.6	1.0	-3.8	2.7	10,500	7,010	44.8	50.7	1.0		4.1	17,600	2.50
	1.7	-5.1	1.0	-1.3	2.9	11,500	7,540	44.3	51.4	1.0		4.6	19,100	2.53
	4.4	-2.9	1.0	1.2	3.2	12,400	7,470	44.2	51.9	1.0		4.7	19,800	2.66
	7.2	-0.1	1.0	4.1	3.1	13,300	7,960	43.8	52.6	1.0		5.1	21,200	2.67
	10.0	2.4	1.0	6.7	3.3	14,000	7,820	43.8	53.2	1.0		5.1	21,800	2.79
	-3.9	-9.7	1.0	-6.4	2.5	9,900	8,100	55.7	61.6	1.0	60	4.3	18,000	2.22
	-1.1	-7.3	1.0	-3.8	2.7	10,500	8,030	55.6	62.1	1.0		4.4	18,600	2.31
	1.7	-4.6	1.0	-1.2	2.9	11,300	8,560	55.2	62.5	1.0		4.8	19,900	2.32
	4.4	-2.2	1.0	1.4	3.1	11,900	8,500	55.2	62.9	1.0		4.8	20,400	2.40
	7.2	0.2	1.0	4.2	3.0	12,800	9,090	54.8	63.2	1.0		5.2	21,900	2.41
	10.0	2.3	1.0	6.8	3.2	13,500	8,960	54.7	64.2	1.0		5.3	22,400	2.50
	-3.9	-9.6	1.0	-6.3	2.5	9,700	9,470	66.5	73.8	1.0	71	4.6	19,200	2.02
	-1.1	-7.1	1.0	-3.8	2.7	10,400	9,360	66.5	74.2	1.0		4.6	19,800	2.11
	1.7	-4.3	1.0	-1.2	2.9	11,200	9,910	66.0	74.7	1.0		5.1	21,200	2.14
	4.4	-1.7	1.0	1.4	3.1	11,800	9,860	66.0	75.0	1.0		5.1	21,700	2.20
	7.2	0.4	1.0	4.2	3.0	12,700	10,490	65.5	75.4	1.0		5.6	23,200	2.21
	10.0	2.3	1.0	6.8	3.2	13,400	10,390	65.5	76.0	1.0		5.6	23,800	2.29

# Dimensions

All dimensions in inches.

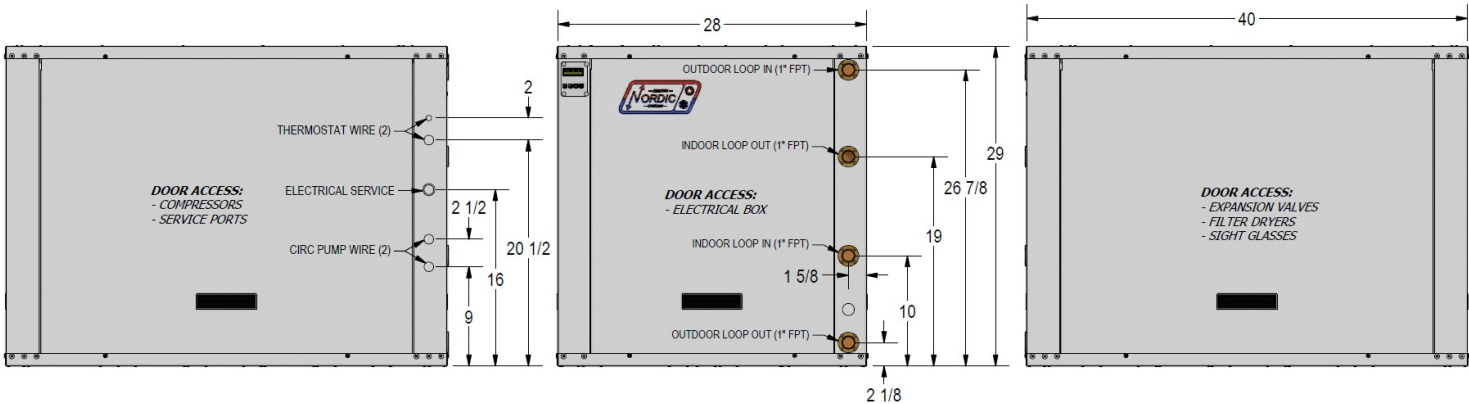


**LEFT SIDE:**  
> 24" service access  
clearance required

**FRONT:**  
> 24" service access  
clearance required

**RIGHT SIDE:**  
> 24" service access  
clearance required

**BACK:**  
no clearance required

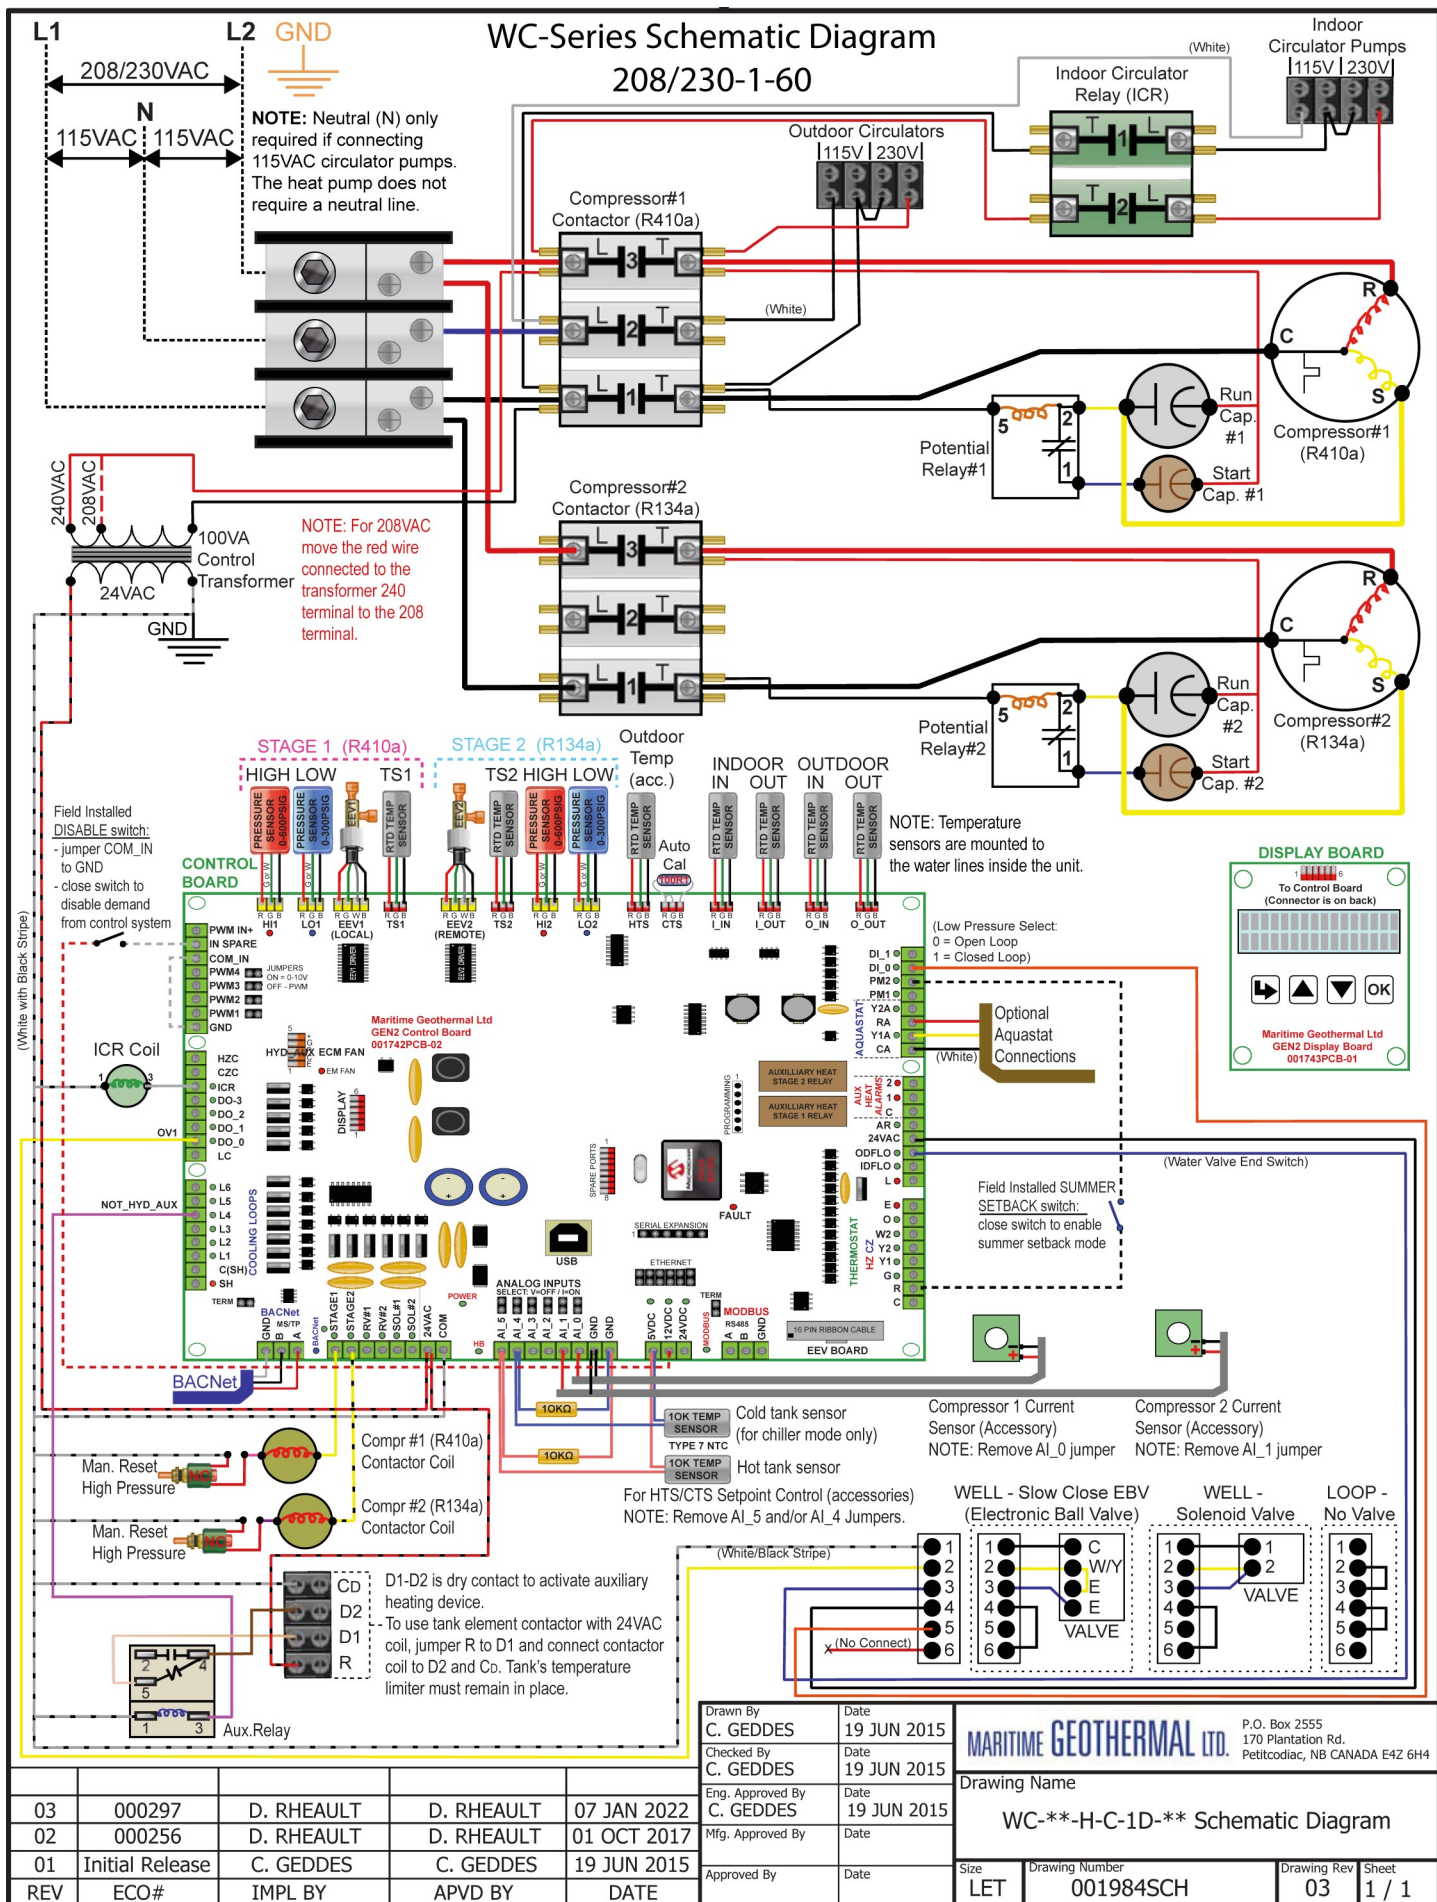



Electrical Box Layout (208/230-1-60)

SYSTEM CONTROL DESCRIPTION

System Control by BACNet or External Control Signals		
BACNet Object	External	Activation
SYSTEM_Y1A	Y1A	Compressor

BACNet INTERFACE CONNECTIONS (MS/TP RS-485)

Use twisted pair shielded, conductor cable to connect the BACNet connections to the control board connector.  
A - Communication (+)  
B - Communication (-)  
GND - Ground

EXTERNAL CONTROL CONNECTIONS (24VAC)

If using an external aquastat ("Signals" control method), use an 18-3 cable for these right side board connections to control compressor demand:  
RA - 24VAC Hot  
CA - Common (for use with RA to power aquastat)  
Y1A - Compressor  
  
A dry contact connection between R/RA and an external control connection (Y1A) will activate the external control signal input to the control board.

POWER SUPPLY CONNECTIONS

\*NOTE: Neutral (N) is only required if connecting 115VAC circulators.  
The heat pump itself does not require a neutral.

208/230/115VAC CONNECTIONS		
Wire	Colour	Contactor (Label)
Line 2	Red	L2
Neutral*	White	N*
Line 1	Black	L1
Connect "GND" to Gnd. Lug		

CIRCULATOR CONNECTIONS (230/115VAC)

REFER TO LABEL IN UNIT FOR MAX LOAD (AMPS)  
Connect 115VAC circulators to 115V  
Connect 230VAC circulators to 230V



AUXILIARY HEAT CONTROL CONNECTIONS

Use an 18-2 cable.  
Choose one of two types of auxiliary heat connections. In either case, default is "ON".  
**Tank's temperature limiter must remain in place.**  
D2 : Dry contacts, closed during call for auxiliary heat  
D1 :  
  
Cd : To use tank element contactor that has a 24VAC coil, jumper R to D1 and connect contactor coil between D2 and Co.  
D2 :  
D1 :  
R :


NOTE: In case of a control system short or overload, rectify the problem and press the black button on the transformer to reset the built-in breaker.

NOTE: For 208VAC move the red wire connected to the 240 terminal of the transformer to the 208 terminal.

WC-Series Electrical Box Diagram  
208/230-1-60

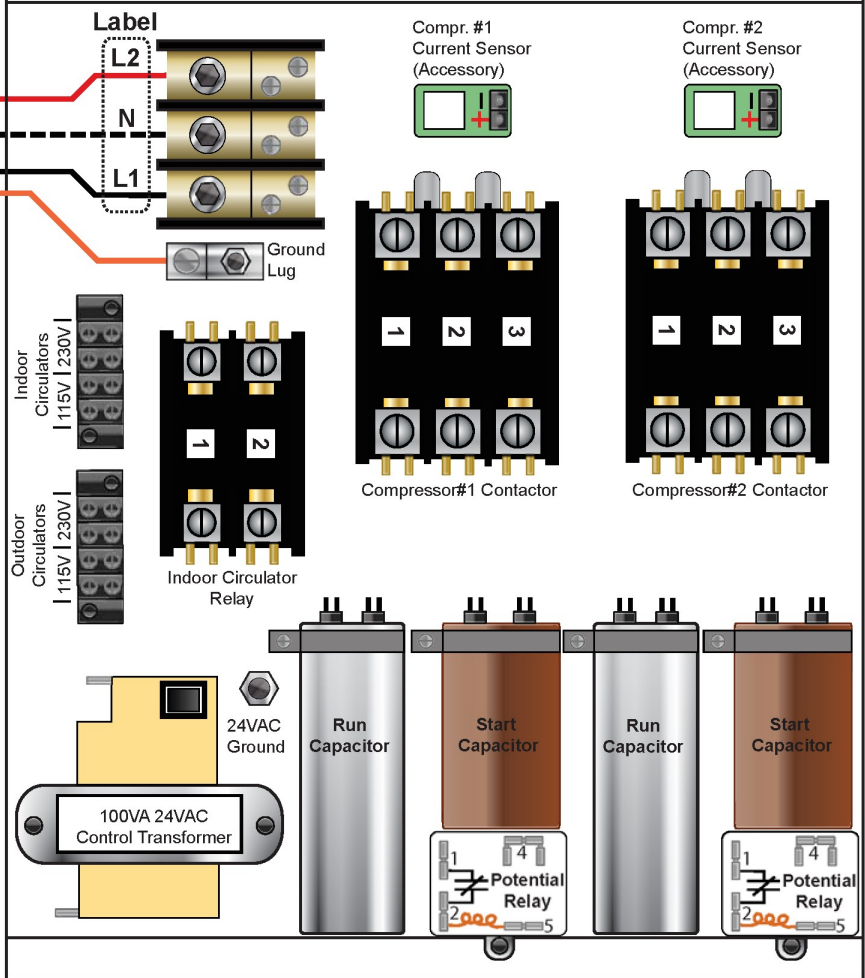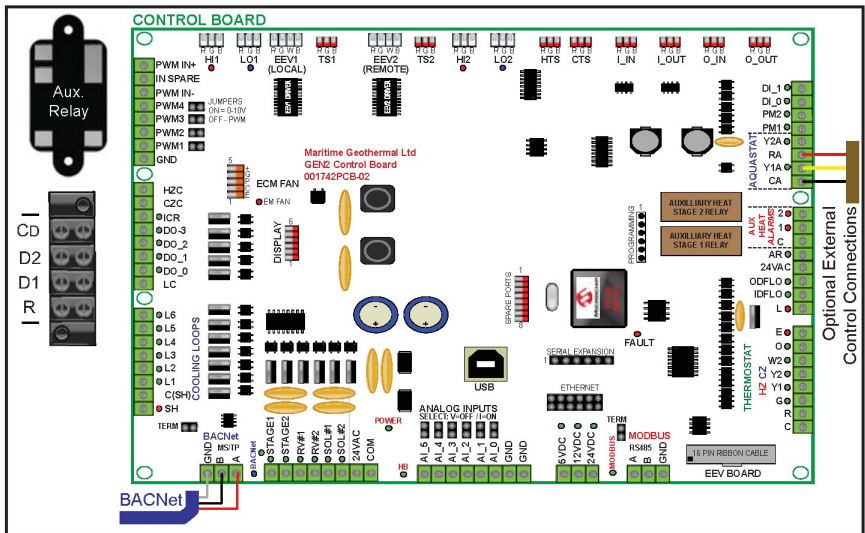

the built-in breaker.					Drawn By C. GEDDES	Date 19 JUN 2015	<div>MARITIME GEOTHERMAL LTD.</div> <div>P.O. Box 2555 170 Plantation Rd. Petitcodiac, NB CANADA E4Z 6H4</div>			
					Checked By C. GEDDES	Date 19 JUN 2015				
					Eng. Approved By C. GEDDES	Date 19 JUN 2015	Drawing Name  WC-**-H-C-1D-** Electrical Box Diagram			
03	000297	D. RHEAULT	D. RHEAULT	07 JAN 2022	Mfg. Approved By	Date				
02	000256	D. RHEAULT	D. RHEAULT	01 OCT 2017			Size LET			
01	Initial Release	C. GEDDES	C. GEDDES	19 JUN 2015	Approved By	Date				
REV	ECO#	IMPL BY	APVD BY	DATE						





# Electrical Box Layout (208-3-60)

## SYSTEM CONTROL DESCRIPTION

System Control by BACNet or External Control Signals		
BACNet Object	External	Activation
SYSTEM_Y1A	Y1A	Compressor

## BACNet INTERFACE CONNECTIONS (MS/TP RS-485)

Use twisted pair shielded, conductor cable to connect the BACNet connections to the control board connector.

A - Communication (+)  
B - Communication (-)  
GND - Ground

## EXTERNAL CONTROL CONNECTIONS (24VAC)

If using an external aquastat ("Signals" control method), use an 18-3 cable for these right side board connections to control compressor demand:

RA - 24VAC Hot  
CA - Common (for use with RA to power aquastat)  
Y1A - Compressor

A dry contact connection between R/RA and an external control connection (Y1A) will activate the external control signal input to the control board.

## POWER SUPPLY CONNECTIONS

\*NOTE: Neutral (N) is only required if connecting 115VAC circulators. The heat pump itself does not require a neutral.

## 208/115VAC CONNECTIONS

Wire	Colour	Contactor (Label)
Neutral*	White	N*
Line 3	Red	L3
Line 2	Blue	L2
Line 1	Black	L1

Connect "GND" to Gnd.Lug

## CIRCULATOR CONNECTIONS (230/115VAC)

REFER TO LABEL IN UNIT FOR MAX LOAD (AMPS)  
Connect 115VAC circulators to 115V  
Connect 230VAC circulators to 230V

## AUXILIARY HEAT CONTROL CONNECTIONS

Use an 18-2 cable.  
Choose one of two types of auxiliary heat connections. In either case, default is "ON".









**Tank's temperature limiter must remain in place.**

D2 : Dry contacts, closed during call for auxiliary heat  
D1 :


CD : To use tank element contactor that has a 24VAC coil, jumper R to D1 and connect contactor coil between D2 and Co.  
D2 :  
D1 :  
R :

## WC-Series Electrical Box Diagram

208-3-60

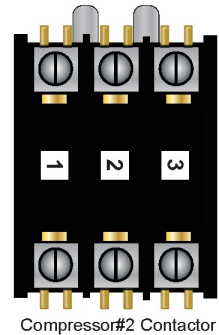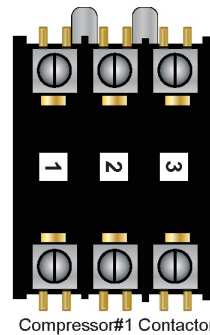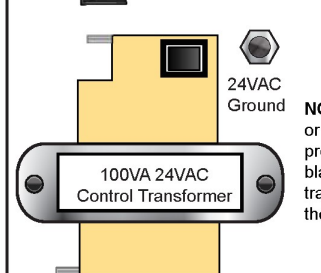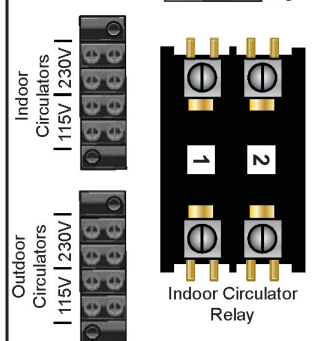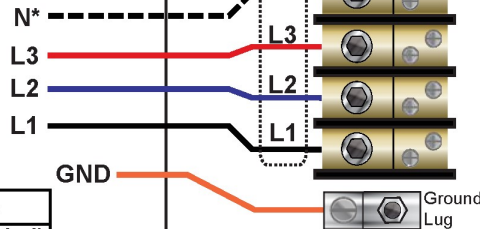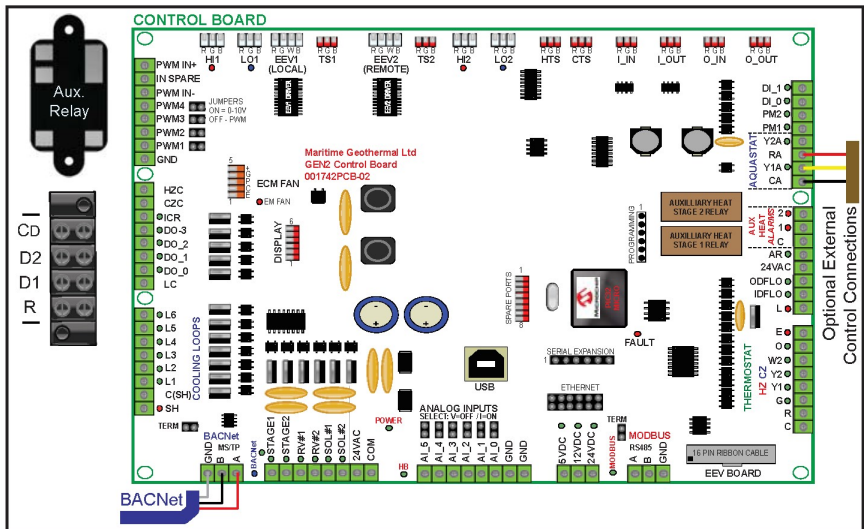

NOTE: In case of short or overload, rectify the problem and press the black button on the transformer to reset the built-in breaker.




Drawn By	C. GEDDES	Date	29 JUN 2016
Checked By	C. GEDDES	Date	29 JUN 2016
Eng. Approved By	C. GEDDES	Date	29 JUN 2016
Mfg. Approved By		Date	
Approved By		Date	

MARITIME GEOTHERMAL LTD.		P.O. Box 2555 170 Plantation Rd. Petitcodiac, NB CANADA E4Z 6H4	
Drawing Name			
WC-**-H-C-2D-** Electrical Box Diagram			
Size	Drawing Number	Drawing Rev	Sheet
1 FT	002162ELB	03	1 / 1

# WC-Series Schematic Diagram

460-3-60

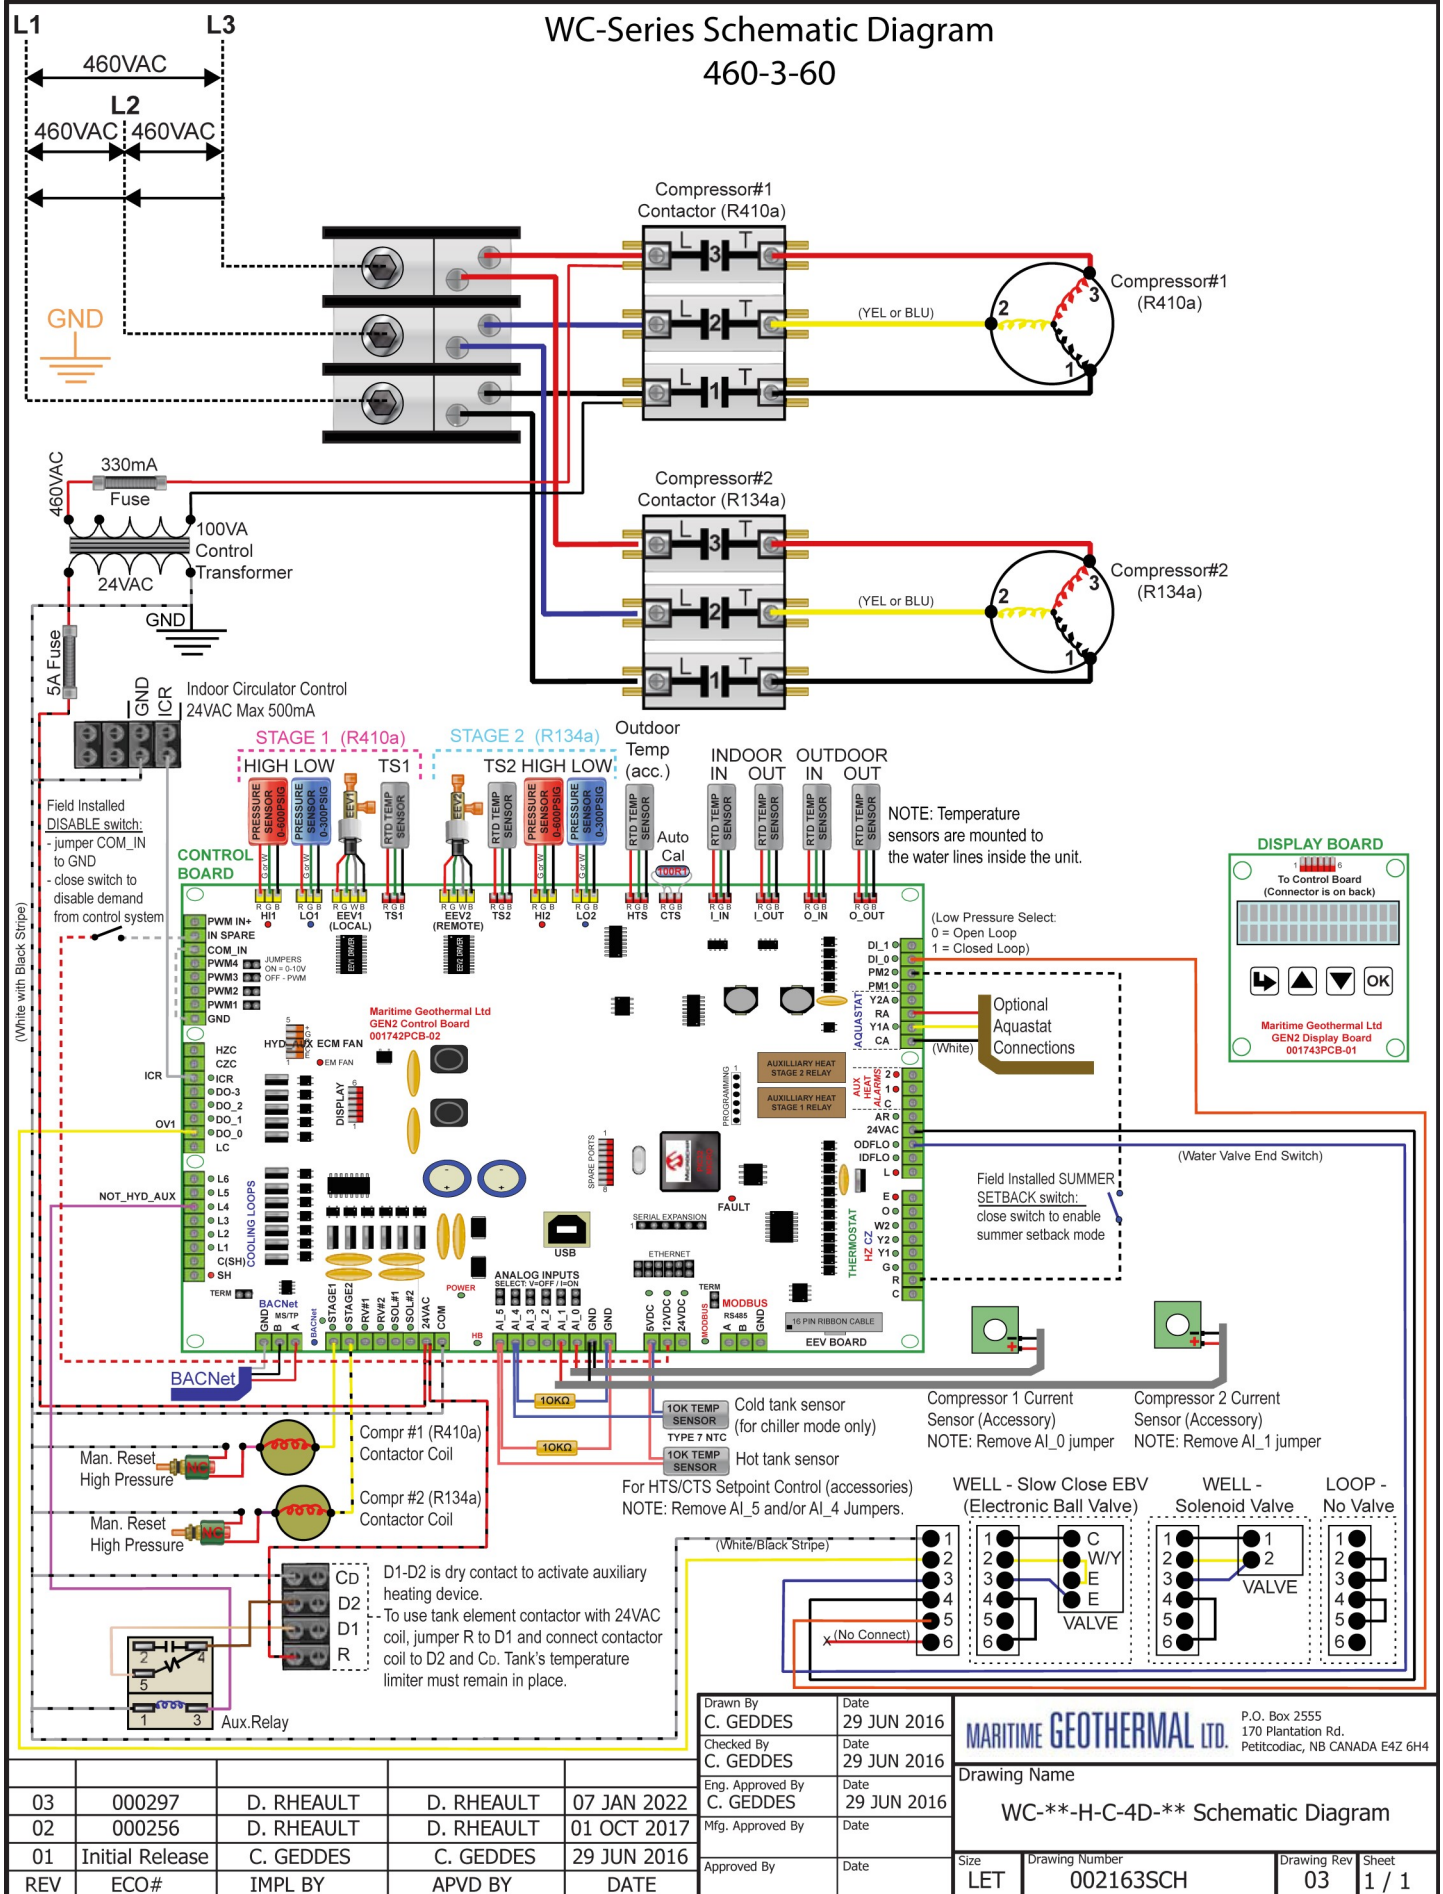

03	000297	D. RHEAULT	D. RHEAULT	07 JAN 2022
02	000256	D. RHEAULT	D. RHEAULT	01 OCT 2017
01	Initial Release	C. GEDDES	C. GEDDES	29 JUN 2016
REV	ECO#	IMPL BY	APVD BY	DATE

Drawn By	C. GEDDES	Date	29 JUN 2016
Checked By	C. GEDDES	Date	29 JUN 2016
Eng. Approved By	C. GEDDES	Date	29 JUN 2016
Mfg. Approved By		Date	
Approved By		Date	

<b>MARITIME GEOTHERMAL LTD.</b> P.O. Box 2555 170 Plantation Rd. Pettitcodiac, NB CANADA E4Z 6H4	
Drawing Name	
WC-**-H-C-4D-** Schematic Diagram	
Size	LET
Drawing Number	002163SCH
Drawing Rev	03
Sheet	1 / 1



Electrical Box Layout (460-3-60)

SYSTEM CONTROL DESCRIPTION

System Control by BACNet or External Control Signals		
BACNet Object	External	Activation
SYSTEM_Y1A	Y1A	Compressor

BACNet INTERFACE CONNECTIONS (MS/TP RS-485)

Use twisted pair shielded, conductor cable to connect the BACNet connections to the control board connector.

A - Communication (+)  
B - Communication (-)  
GND - Ground

EXTERNAL CONTROL CONNECTIONS (24VAC)

If using an external aquastat ("Signals" control method), use an 18-3 cable for these right side board connections to control compressor demand:

RA - 24VAC Hot  
CA - Common (for use with RA to power aquastat)  
Y1A - Compressor

A dry contact connection between R/RA and an external control connection (Y1A) will activate the external control signal input to the control board.

POWER SUPPLY CONNECTIONS

460VAC CONNECTIONS		
Wire	Colour	Contactors (Label)
Line 3	Red	L3
Line 2	Blue	L2
Line 1	Black	L1

Connect "GND" to Ground Lug

INDOOR CIRCULATOR CONTROL (24VAC)

Use an 18-2 conductor cable. Connect the output signals as per the descriptions below:

GND - 24VAC Common  
ICR - 24VAC Indoor Circulator Control (Hot)

ICR is used for sampling when system is operating under the Setpoint Control method. May be used to power a contactor or relay. **Max load 500mA.**

AUXILIARY HEAT CONTROL CONNECTIONS

Use an 18-2 cable.

Choose one of two types of auxiliary heat connections. In either case, default is "ON".


**Tank's temperature limiter must remain in place.**

D2 :  
D1 : Dry contacts, closed during call for auxiliary heat

CD :  
D2 : To use tank element contactor that has a 24VAC coil, jumper R to D1 and connect contactor coil between D1 D2 and Co.  
D1 :  
R :

03	000297	D. RHEAULT	D. RHEAULT	07 JAN 2022
02	000256	D. RHEAULT	D. RHEAULT	01 OCT 2017
01	Initial Release	C. GEDDES	C. GEDDES	29 JUN 2016
REV	ECO#	IMPL BY	APVD BY	DATE

WC-Series Electrical Box Diagram  
460-3-60

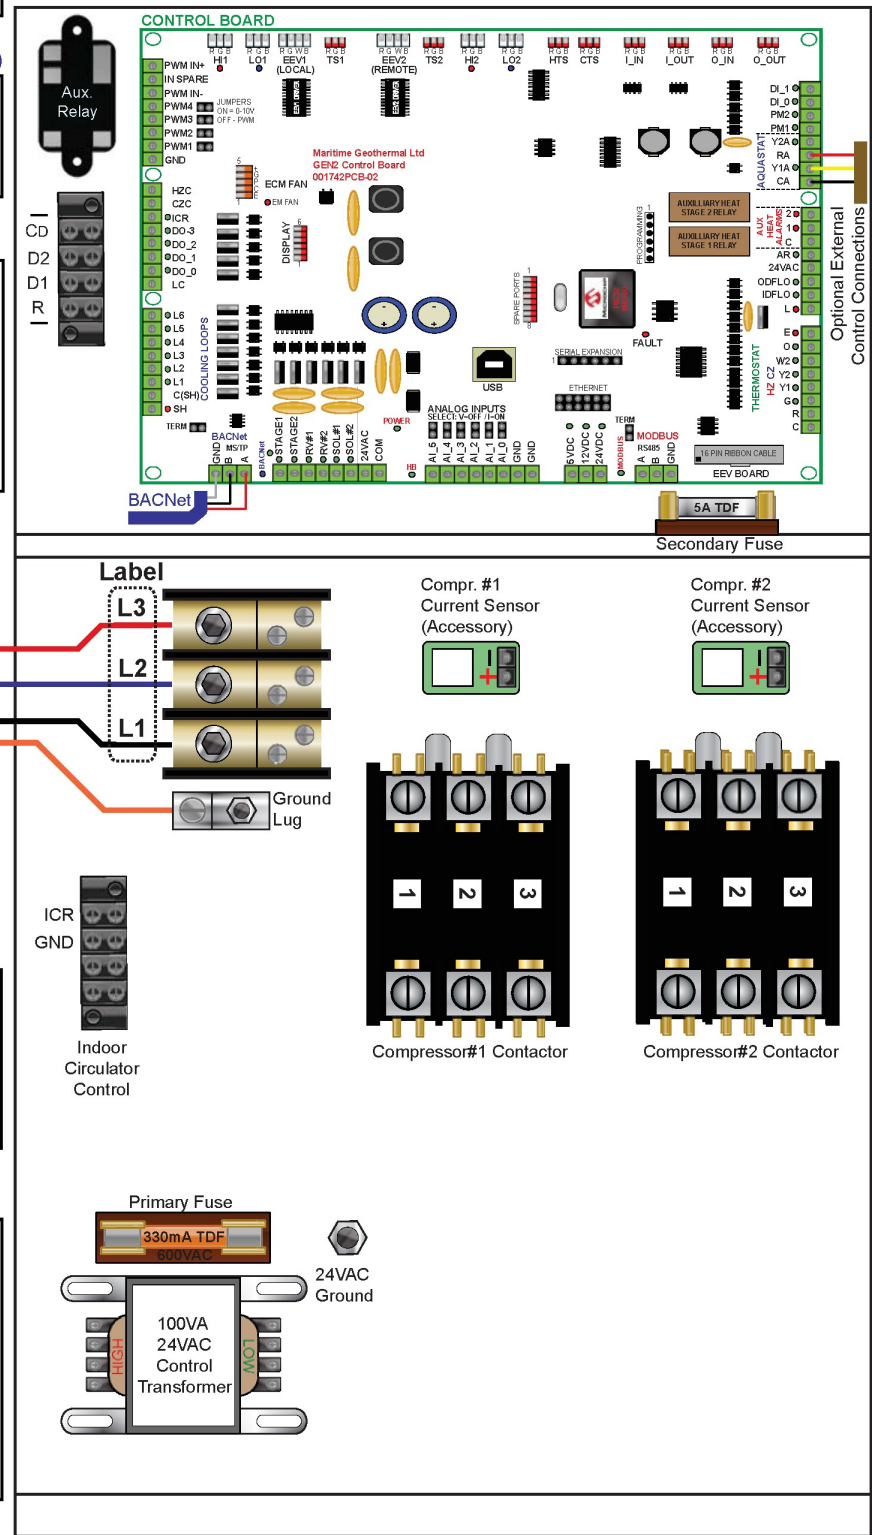

Drawn By C. GEDDES	Date 29 JUN 2016	MARITIME GEOTHERMAL LTD. P.O. Box 2555 170 Plantation Rd. Petitcodiac, NB CANADA E4Z 6H4
Checked By C. GEDDES	Date 29 JUN 2016	
Eng. Approved By C. GEDDES	Date 29 JUN 2016	
Mfg. Approved By	Date	
Approved By	Date	Drawing Name WC-**-H-C-4D-** Electrical Box Diagram
Size LET	Drawing Number 002164ELB	Drawing Rev 03
		Sheet 1 / 1

# WC-Series Schematic Diagram

## 575-3-60

**Power Supply:** L1, L2, L3 (575VAC). L2 is split into two 575VAC sections. GND is connected to the ground plane.

**Compressor#1 (R410a) Contactor (R410a):** L1, L2, L3 terminals. (YEL or BLU) wire connects to terminal 2. Compressor#1 (R410a) is connected to terminals 1, 2, and 3.

**Compressor#2 (R134a) Contactor (R134a):** L1, L2, L3 terminals. (YEL or BLU) wire connects to terminal 2. Compressor#2 (R134a) is connected to terminals 1, 2, and 3.

**Indoor Circulator Control:** 250mA Fuse, 575VAC, 100VA Control Transformer, 24VAC, GND, 5A Fuse, ICR.

**Control Board:** STAGE 1 (R410a) HIGH LOW TS1, STAGE 2 (R134a) TS2 HIGH LOW. Includes pressure sensors (0-600PSIG), RTD temp sensors (0-300PSIG), and a 24VAC Max 500mA output.

**Outdoor Temp (acc.):** INDOOR IN, OUTDOOR IN, OUTDOOR OUT. Includes RTD temp sensors and a 24VAC output.

**Field Installed DISABLE switch:** jumper COM\_IN to GND, close switch to disable demand from control system.

**DISPLAY BOARD:** Maritime Geothermal Ltd GEN2 Display Board 001743PCB-01. Includes a 10-pin ribbon cable connector and a 10-pin ribbon cable.

**Optional Aquastat Connections:** (White) connections for Y2A, Y2B, Y2C, Y2D, Y2E, Y2F, Y2G, Y2H, Y2I, Y2J, Y2K, Y2L, Y2M, Y2N, Y2O, Y2P, Y2Q, Y2R, Y2S, Y2T, Y2U, Y2V, Y2W, Y2X, Y2Y, Y2Z, Y2AA, Y2AB, Y2AC, Y2AD, Y2AE, Y2AF, Y2AG, Y2AH, Y2AI, Y2AJ, Y2AK, Y2AL, Y2AM, Y2AN, Y2AO, Y2AP, Y2AQ, Y2AR, Y2AS, Y2AT, Y2AU, Y2AV, Y2AW, Y2AX, Y2AY, Y2AZ, Y2BA, Y2BB, Y2BC, Y2BD, Y2BE, Y2BF, Y2BG, Y2BH, Y2BI, Y2BJ, Y2BK, Y2BL, Y2BM, Y2BN, Y2BO, Y2BP, Y2BQ, Y2BR, Y2BS, Y2BT, Y2BU, Y2BV, Y2BW, Y2BX, Y2BY, Y2BZ, Y2CA, Y2CB, Y2CC, Y2CD, Y2CE, Y2CF, Y2CG, Y2CH, Y2CI, Y2CJ, Y2CK, Y2CL, Y2CM, Y2CN, Y2CO, Y2CP, Y2CQ, Y2CR, Y2CS, Y2CT, Y2CU, Y2CV, Y2CW, Y2CX, Y2CY, Y2CZ, Y2DA, Y2DB, Y2DC, Y2DD, Y2DE, Y2DF, Y2DG, Y2DH, Y2DI, Y2DJ, Y2DK, Y2DL, Y2DM, Y2DN, Y2DO, Y2DP, Y2DQ, Y2DR, Y2DS, Y2DT, Y2DU, Y2DV, Y2DW, Y2DX, Y2DY, Y2DZ, Y2EA, Y2EB, Y2EC, Y2ED, Y2EE, Y2EF, Y2EG, Y2EH, Y2EI, Y2EJ, Y2EK, Y2EL, Y2EM, Y2EN, Y2EO, Y2EP, Y2EQ, Y2ER, Y2ES, Y2ET, Y2EU, Y2EV, Y2EW, Y2EX, Y2EY, Y2EZ, Y2FA, Y2FB, Y2FC, Y2FD, Y2FE, Y2FF, Y2FG, Y2FH, Y2FI, Y2FJ, Y2FK, Y2FL, Y2FM, Y2FN, Y2FO, Y2FP, Y2FQ, Y2FR, Y2FS, Y2FT, Y2FU, Y2FV, Y2FW, Y2FX, Y2FY, Y2FZ, Y2GA, Y2GB, Y2GC, Y2GD, Y2GE, Y2GF, Y2GG, Y2GH, Y2GI, Y2GJ, Y2GK, Y2GL, Y2GM, Y2GN, Y2GO, Y2GP, Y2GQ, Y2GR, Y2GS, Y2GT, Y2GU, Y2GV, Y2GW, Y2GX, Y2GY, Y2GZ, Y2HA, Y2HB, Y2HC, Y2HD, Y2HE, Y2HF, Y2HG, Y2HH, Y2HI, Y2HJ, Y2HK, Y2HL, Y2HM, Y2HN, Y2HO, Y2HP, Y2HQ, Y2HR, Y2HS, Y2HT, Y2HU, Y2HV, Y2HW, Y2HX, Y2HY, Y2HZ, Y2IA, Y2IB, Y2IC, Y2ID, Y2IE, Y2IF, Y2IG, Y2IH, Y2II, Y2IJ, Y2IK, Y2IL, Y2IM, Y2IN, Y2IO, Y2IP, Y2IQ, Y2IR, Y2IS, Y2IT, Y2IU, Y2IV, Y2IW, Y2IX, Y2IY, Y2IZ, Y2JA, Y2JB, Y2JC, Y2JD, Y2JE, Y2JF, Y2JG, Y2JH, Y2JI, Y2JJ, Y2JK, Y2JL, Y2JM, Y2JN, Y2JO, Y2JP, Y2JQ, Y2JR, Y2JS, Y2JT, Y2JU, Y2JV, Y2JW, Y2JX, Y2JY, Y2JZ, Y2KA, Y2KB, Y2KC, Y2KD, Y2KE, Y2KF, Y2KG, Y2KH, Y2KI, Y2KJ, Y2KK, Y2KL, Y2KM, Y2KN, Y2KO, Y2KP, Y2KQ, Y2KR, Y2KS, Y2KT, Y2KU, Y2KV, Y2KW, Y2KX, Y2KY, Y2KZ, Y2LA, Y2LB, Y2LC, Y2LD, Y2LE, Y2LF, Y2LG, Y2LH, Y2LI, Y2LJ, Y2LK, Y2LL, Y2LM, Y2LN, Y2LO, Y2LP, Y2LQ, Y2LR, Y2LS, Y2LT, Y2LU, Y2LV, Y2LW, Y2LX, Y2LY, Y2LZ, Y2MA, Y2MB, Y2MC, Y2MD, Y2ME, Y2MF, Y2MG, Y2MH, Y2MI, Y2MJ, Y2MK, Y2ML, Y2MM, Y2MN, Y2MO, Y2MP, Y2MQ, Y2MR, Y2MS, Y2MT, Y2MU, Y2MV, Y2MW, Y2MX, Y2MY, Y2MZ, Y2NA, Y2NB, Y2NC, Y2ND, Y2NE, Y2NF, Y2NG, Y2NH, Y2NI, Y2NJ, Y2NK, Y2NL, Y2NM, Y2NN, Y2NO, Y2NP, Y2NQ, Y2NR, Y2NS, Y2NT, Y2NU, Y2NV, Y2NW, Y2NX, Y2NY, Y2NZ, Y2OA, Y2OB, Y2OC, Y2OD, Y2OE, Y2OF, Y2OG, Y2OH, Y2OI, Y2OJ, Y2OK, Y2OL, Y2OM, Y2ON, Y2OO, Y2OP, Y2OQ, Y2OR, Y2OS, Y2OT, Y2OU, Y2OV, Y2OW, Y2OX, Y2OY, Y2OZ, Y2PA, Y2PB, Y2PC, Y2PD, Y2PE, Y2PF, Y2PG, Y2PH, Y2PI, Y2PJ, Y2PK, Y2PL, Y2PM, Y2PN, Y2PO, Y2PP, Y2PQ, Y2PR, Y2PS, Y2PT, Y2PU, Y2PV, Y2PW, Y2PX, Y2PY, Y2PZ, Y2QA, Y2QB, Y2QC, Y2QD, Y2QE, Y2QF, Y2QG, Y2QH, Y2QI, Y2QJ, Y2QK, Y2QL, Y2QM, Y2QN, Y2QO, Y2QP, Y2QQ, Y2QR, Y2QS, Y2QT, Y2QU, Y2QV, Y2QW, Y2QX, Y2QY, Y2QZ, Y2RA, Y2RB, Y2RC, Y2RD, Y2RE, Y2RF, Y2RG, Y2RH, Y2RI, Y2RJ, Y2RK, Y2RL, Y2RM, Y2RN, Y2RO, Y2RP, Y2RQ, Y2RR, Y2RS, Y2RT, Y2RU, Y2RV, Y2RW, Y2RX, Y2RY, Y2RZ, Y2SA, Y2SB, Y2SC, Y2SD, Y2SE, Y2SF, Y2SG, Y2SH, Y2SI, Y2SJ, Y2SK, Y2SL, Y2SM, Y2SN, Y2SO, Y2SP, Y2SQ, Y2SR, Y2SS, Y2ST, Y2SU, Y2SV, Y2SW, Y2SX, Y2SY, Y2SZ, Y2TA, Y2TB, Y2TC, Y2TD, Y2TE, Y2TF, Y2TG, Y2TH, Y2TI, Y2TJ, Y2TK, Y2TL, Y2TM, Y2TN, Y2TO, Y2TP, Y2TQ, Y2TR, Y2TS, Y2TT, Y2TU, Y2TV, Y2TW, Y2TX, Y2TY, Y2TZ, Y2UA, Y2UB, Y2UC, Y2UD, Y2UE, Y2UF, Y2UG, Y2UH, Y2UI, Y2UJ, Y2UK, Y2UL, Y2UM, Y2UN, Y2UO, Y2UP, Y2UQ, Y2UR, Y2US, Y2UT, Y2UU, Y2UV, Y2UW, Y2UX, Y2UY, Y2UZ, Y2VA, Y2VB, Y2VC, Y2VD, Y2VE, Y2VF, Y2VG, Y2VH, Y2VI, Y2VJ, Y2VK, Y2VL, Y2VM, Y2VN, Y2VO, Y2VP, Y2VQ, Y2VR, Y2VS, Y2VT, Y2VU, Y2VV, Y2VW, Y2VX, Y2VY, Y2VZ, Y2WA, Y2WB, Y2WC, Y2WD, Y2WE, Y2WF, Y2WG, Y2WH, Y2WI, Y2WJ, Y2WK, Y2WL, Y2WM, Y2WN, Y2WO, Y2WP, Y2WQ, Y2WR, Y2WS, Y2WT, Y2WU, Y2WV, Y2WW, Y2WX, Y2WY, Y2WZ, Y2XA, Y2XB, Y2XC, Y2XD, Y2XE, Y2XF, Y2XG, Y2XH, Y2XI, Y2XJ, Y2XK, Y2XL, Y2XM, Y2XN, Y2XO, Y2XP, Y2XQ, Y2XR, Y2XS, Y2XT, Y2XU, Y2XV, Y2XW, Y2XX, Y2XY, Y2XZ, Y2YA, Y2YB, Y2YC, Y2YD, Y2YE, Y2YF, Y2YG, Y2YH, Y2YI, Y2YJ, Y2YK, Y2YL, Y2YM, Y2YN, Y2YO, Y2YP, Y2YQ, Y2YR, Y2YS, Y2YT, Y2YU, Y2YV, Y2YW, Y2YX, Y2YY, Y2YZ, Y2ZA, Y2ZB, Y2ZC, Y2ZD, Y2ZE, Y2ZF, Y2ZG, Y2ZH, Y2ZI, Y2ZJ, Y2ZK, Y2ZL, Y2ZM, Y2ZN, Y2ZO, Y2ZP, Y2ZQ, Y2ZR, Y2ZS, Y2ZT, Y2ZU, Y2ZV, Y2ZW, Y2ZX, Y2ZY, Y2ZZ.

**Field Installed SUMMER SETBACK switch:** close switch to enable summer setback mode.

**Water Valve End Switch:** (Water Valve End Switch).

**Compressor 1 Current Sensor (Accessory):** NOTE: Remove AI\_0 jumper.

**Compressor 2 Current Sensor (Accessory):** NOTE: Remove AI\_1 jumper.

**WELL - Slow Close EBV (Electronic Ball Valve):** 1, 2, 3, 4, 5, 6 terminals. (White/Black Stripe) wire connects to terminal 1. (No Connect) wire connects to terminal 6.

**WELL - Solenoid Valve:** 1, 2, 3, 4, 5, 6 terminals. (White/Black Stripe) wire connects to terminal 1. (No Connect) wire connects to terminal 6.

**LOOP - No Valve:** 1, 2, 3, 4, 5, 6 terminals. (White/Black Stripe) wire connects to terminal 1. (No Connect) wire connects to terminal 6.

**Man. Reset High Pressure:** Man. Reset High Pressure switch.

**Man. Reset High Pressure:** Man. Reset High Pressure switch.

**Compr #1 (R410a) Contactor Coil:** 1, 2, 3, 4, 5, 6 terminals. (White/Black Stripe) wire connects to terminal 1. (No Connect) wire connects to terminal 6.



**Compr #2 (R134a) Contactor Coil:** 1, 2, 3, 4, 5, 6 terminals. (White/Black Stripe) wire connects to terminal 1. (No Connect) wire connects to terminal 6.

**CD, D2, D1, R:** D1-D2 is dry contact to activate auxiliary heating device. To use tank element contactor with 24VAC coil, jumper R to D1 and connect contactor coil to D2 and Co. Tank's temperature limiter must remain in place.

**Field Installed DISABLE switch:** jumper COM\_IN to GND, close switch to disable demand from control system.

**DISPLAY BOARD:** Maritime Geothermal Ltd GEN2 Display Board 001743PCB-01. Includes a 10-pin ribbon cable connector and a 10-pin ribbon cable.

**Optional Aquastat Connections:** (White) connections for Y2A, Y2B, Y2C, Y2D, Y2E, Y2F, Y2G, Y2H, Y2I, Y2J, Y2K, Y2L, Y2M

					Drawn By C. GEDDES	Date 29 JUN 2016	<div>  <div>             P.O. Box 2555              170 Plantation Rd.              Petitcodiac, NB CANADA E4Z 6H4           </div> </div>			
					Checked By C. GEDDES	Date 29 JUN 2016	Drawing Name  WC-*-H-C-5D-* Schematic Diagram			
					Eng. Approved By C. GEDDES	Date 29 JUN 2016				
					Mfg. Approved By	Date				
03	000297	D. RHEAULT	D. RHEAULT	07 JAN 2022	Approved By	Date	Size LET	Drawing Number 002165SCH	Drawing Rev 03	Sheet 1 / 1
02	000256	D. RHEAULT	D. RHEAULT	01 OCT 2017						
01	Initial Release	C. GEDDES	C. GEDDES	29 JUN 2016						
REV	ECO#	IMPL BY	APVD BY	DATE						



# Electrical Box Layout (575-3-60)

## WC-Series Electrical Box Diagram 575-3-60

### SYSTEM CONTROL DESCRIPTION

System Control by BACNet or External Control Signals		
BACNet Object	External	Activation
SYSTEM_Y1A	Y1A	Compressor

### BACNet INTERFACE CONNECTIONS (MS/TP RS-485)

Use twisted pair shielded, conductor cable to connect the BACNet connections to the control board connector.

A - Communication (+)

B - Communication (-)

GND - Ground

### EXTERNAL CONTROL CONNECTIONS (24VAC)

If using an external aquastat ("Signals" control method), use an 18-3 cable for these right side board connections to control compressor demand:

RA - 24VAC Hot

CA - Common (for use with RA to power aquastat)

Y1A - Compressor

A dry contact connection between R/RA and an external control connection (Y1A) will activate the external control signal input to the control board.

### POWER SUPPLY CONNECTIONS

575VAC CONNECTIONS		
Wire	Colour	Contact (Label)
Line 3	Red	L3
Line 2	Blue	L2
Line 1	Black	L1

Connect "GND" to Ground Lug

### INDOOR CIRCULATOR CONTROL (24VAC)

Use an 18-2 conductor cable. Connect the output signals as per the descriptions below:

GND - 24VAC Common

ICR - 24VAC Indoor Circulator Control (Hot)

ICR is used for sampling when system is operating under the Setpoint Control method. May be used to power a contactor or relay. **Max load 500mA.**

### AUXILIARY HEAT CONTROL CONNECTIONS

Use an 18-2 cable.




Choose one of two types of auxiliary heat connections. In either case, default is "ON".

**Tank's temperature limiter must remain in place.**

D2 : Dry contacts, closed during call for auxiliary heat

D1 : Dry contacts, closed during call for auxiliary heat


Cd : To use tank element contactor that has a 24VAC coil, jumper R to D1 and connect contactor coil between D2 and Co.

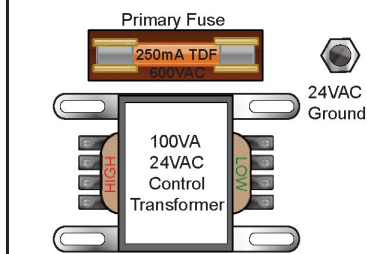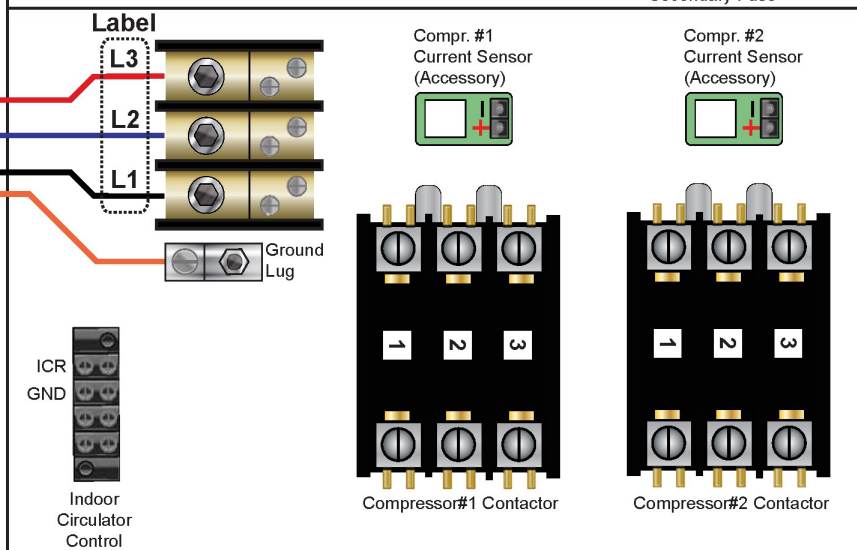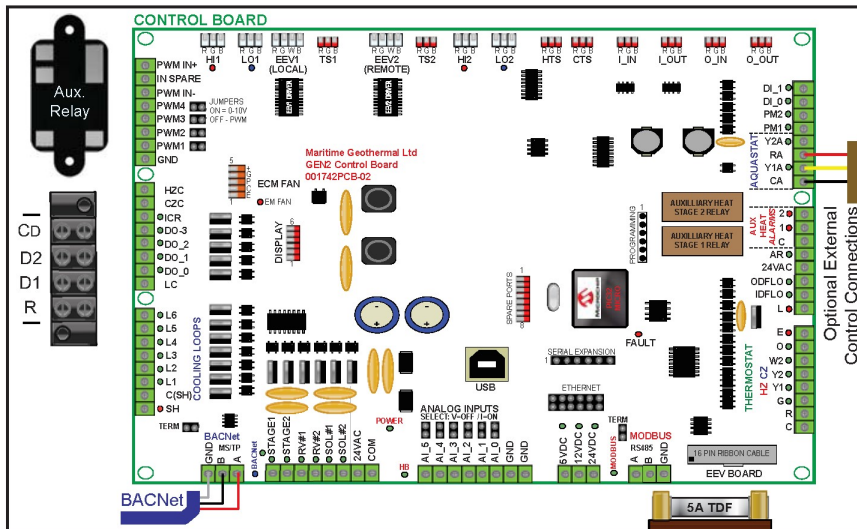

Drawn By C. GEDDES	Date 29 JUN 2016
Checked By C. GEDDES	Date 29 JUN 2016
Eng. Approved By C. GEDDES	Date 29 JUN 2016
Mfg. Approved By	Date
Approved By	Date

MARITIME GEOTHERMAL LTD.		P.O. Box 2555 170 Plantation Rd. Petitcodiac, NB CANADA E4Z 6H4	
Drawing Name WC-**-H-C-5D-** Electrical Box Diagram			
Size LET	Drawing Number 002166ELB	Drawing Rev 03	Sheet 1 / 1

WC-Series Refrigeration Circuit

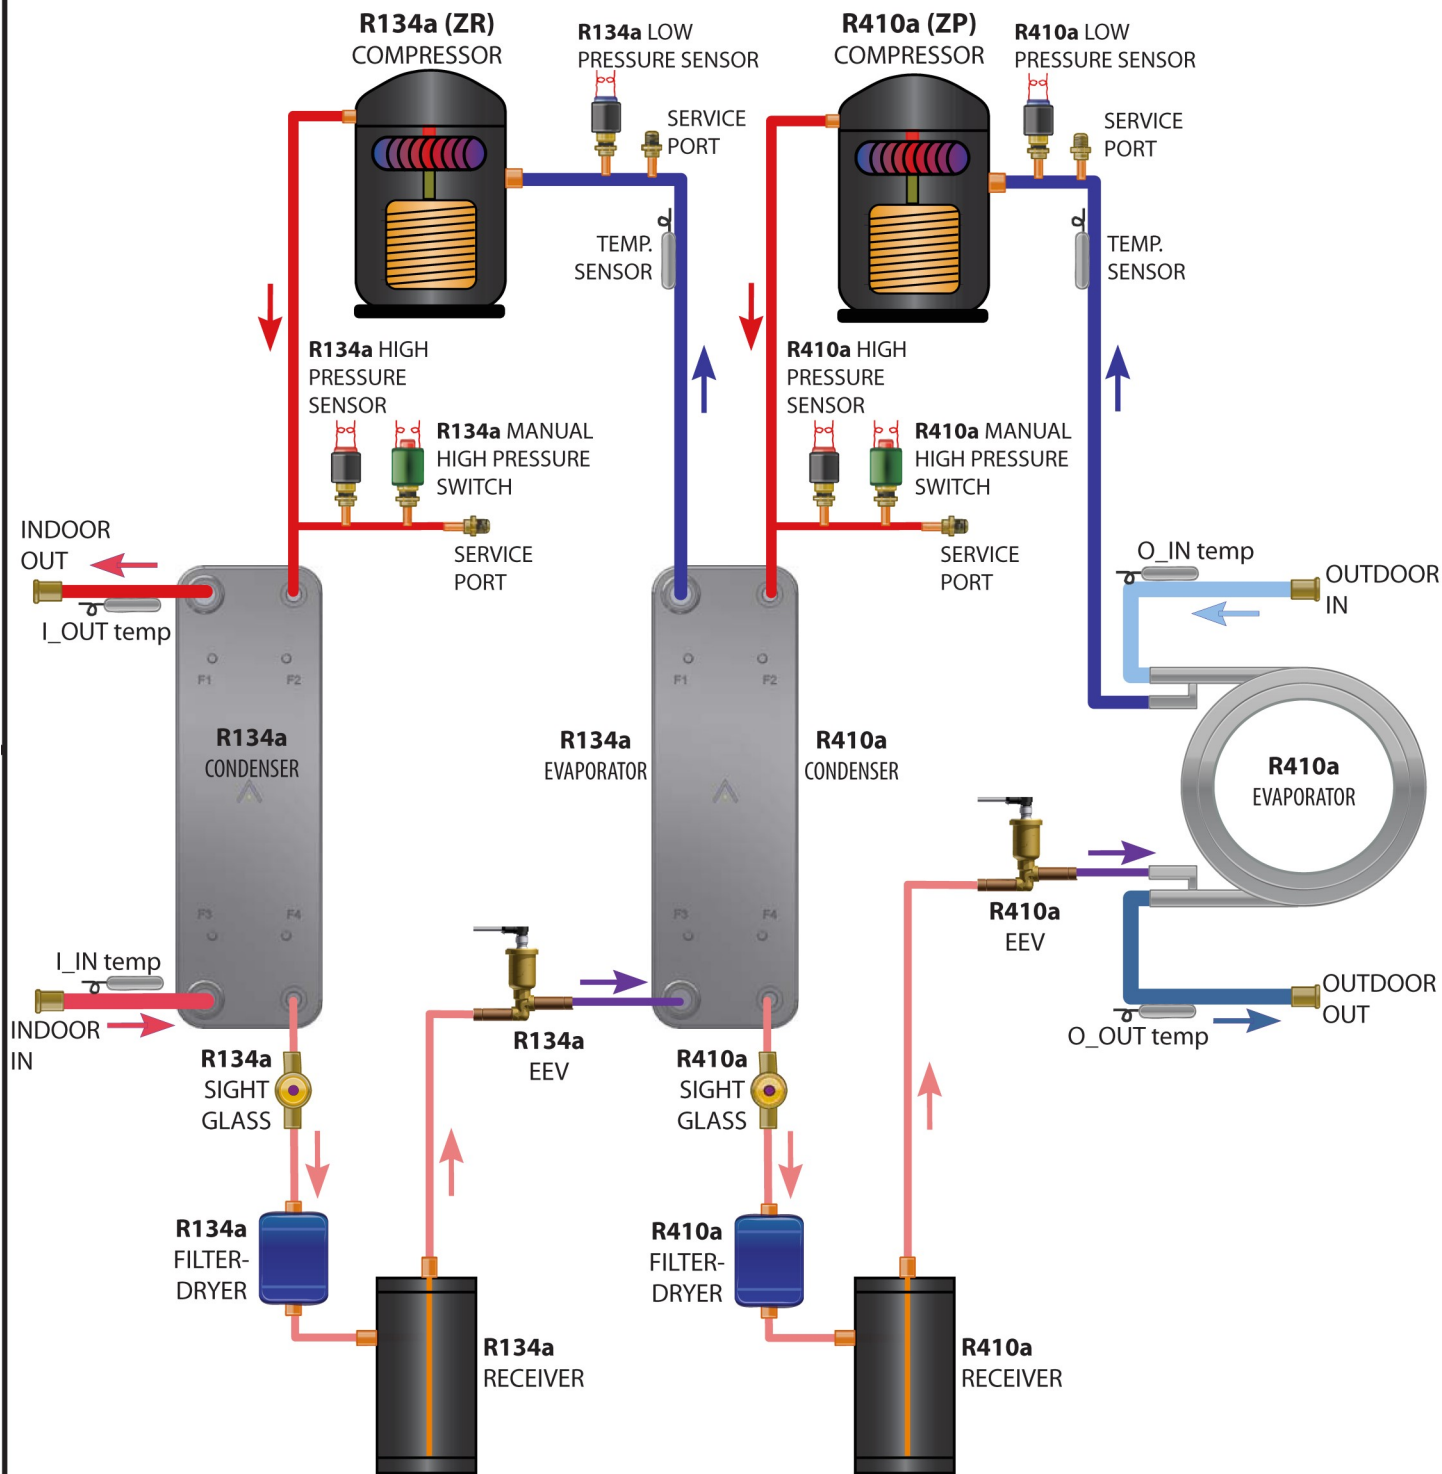

					Drawn By DAN RHEULT	Date 22-JUN-2015	<div><div>MARITIME GEOTHERMAL LTD.</div><div>P.O. Box 2555 170 Plantation Rd. Pettitcodiac, NB CANADA E4Z 6H4</div></div> <div>Drawing Name WC-Series Refrigeration Circuit</div>			
					Checked By DAN RHEULT	Date 22-JUN-2015				
					Eng. Approved By	Date				
					Mfg. Approved By	Date				
01	Initial Release	D. RHEULT	D. RHEULT	22-JUN-2015	Approved By	Date	Size LET	Drawing Number 001996RCD	Drawing Revision 01	Sheet 1 / 1
REV	ECO#	IMPL BY	APVD BY	DATE						

## BACnet Interface

The BACnet interface is an **MS/TP** connection via RS-485 twisted pair. BACnet **IP** is not available.  
Recommended wire: 22-24 AWG single twisted pair, 100-120 Ohms impedance, 17pF/ft or lower capacitance, with braided or aluminum foil shield, such as Belden 9841 or 89841.

The connector on the control board is a three wire removable screw connector. The signals are as follows:

- A: Communications line (+) (right pin)  
B: Communications line (-) (middle pin)  
C: Ground connection (left pin)

If connecting multiple units to one RS-485 connection point, connect the signal cable from the master building controller to the first unit. Connect the second unit to the first unit (in same connector), connect the third unit to the second unit, and so on until all units are connected (daisy-chain). Remove the TERM jumper (located just above the BACnet connector on control board) from all units except the last one. The shield ground should be connected only to the GND pin of the unit for single unit installations. For multiple units, the shield ground should only be connected to the GND pin of the last unit. The shield grounds for intermediate units should be connected together. The shield ground should be left unconnected at the building controller end for all cases.

Vendor: Maritime Geothermal Ltd.  
Vendor ID: 260  
Model Name: MGT GEN2 Control Board

The following parameters can be set  
PC App's *Configuration* Window:

- 1) **Baud rate**  
9600, 19200, 38400, or 76800
- 2) **MAC address**  
Maximum value is 125.
- 3) **Instance number**  
Maximum value is 4194303.

HYD AUX in Defrost	<div>BACnet Configuration</div> <div> <div>Baudrate</div> <div>MAC Address</div> <div>Instance#</div> <div>Max Info Frames</div> </div>			
OD Fan Reduction	76800	125	980000	8

**IMPORTANT: Cycle power to invoke changes.**

via the

The BACnet parameter **Max\_Master** has a fixed value of **127** in this device.

BACnet data is available regardless of the selected control method. In order to control the unit via the BACnet interface, set **Control Source** to **BACnet** either by using the PC App's configuration window or the LCD menus.

For tables listing BACnet objects, refer to **Installation and Service Manual**.

# Engineering Guide Specifications

---

## General

The liquid source water-to-water heat pump shall be a single packaged cascade high temperature heating unit. The unit shall be listed by a nationally recognized safety-testing lab (NRTL), such as ETL, TUV, UL or CSA. The unit shall be rated in accordance with applicable standards of the Air Conditioning, Heating, and Refrigeration Institute / International Standards Organization (AHRI/ISO) and/or Canadian Standards Association (CSA), if any. The liquid source water to water heat pump unit, as manufactured by Maritime Geothermal, Petitcodiac, New Brunswick, shall be designed to operate correctly within liquid temperature ranges specified on the "Minimum and Maximum Operating Temperatures" page of this engineering specification document.

## Factory Quality

Each unit shall be run tested at the factory with water circulating in both indoor and outdoor loops. Quality control system checks shall include: computerized nitrogen pressurized leak test, evacuation of refrigeration circuit to sustained vacuum, accurate system charge, detailed heating and cooling mode tests, and quality cross check all operational and test conditions to pass/fail criteria. Units tested without water flow are not acceptable. The units shall be warranted by the manufacturer against defects in materials and workmanship in accordance with the warranty section at the end of this document. Optional extended factory warranty coverage may be available.

## Cabinet

Each unit shall be enclosed in a sheet metal cabinet. Cabinet shall be constructed of powder coated galvanized sheet metal of minimum 20 gauge. Sheet metal gauge shall be higher where structurally required. Design and construction of cabinet shall be such that it is rigid and passes the CSA/UL Loading Test requirements (200 lb roof test). All panels shall be lined with minimum 1/2 inch [12.7 mm] thick acoustic type glass fiber insulation. All insulation shall meet the fire retardant provisions of NFPA 90A. This material shall also provide acoustical benefit. The unit must have a minimum of four access panels for serviceability of the compressor compartment. Units having only one access panel to compressor/heat exchangers/expansion device/refrigerant piping shall not be acceptable. The electrical box shall have separate holes and knockouts for entrance of line voltage and low voltage control wiring. All factory-installed wiring passing through factory knockouts and openings shall be protected from sheet metal edges at openings by plastic grommets.

## Refrigerant Circuit

All units shall contain two sealed refrigerant circuits, containing hermetic motor scroll compressors, Electronic Expansion Valves (EEVs), coaxial outdoor loop heat exchanger, brazed plate intermediate refrigerant-to-refrigerant and indoor loop heat exchangers, factory installed high and low pressure sensors, manual reset high pressure switches, service ports, liquid line filter-dryers, sight glasses, and suction accumulators.

Compressors shall be specified for heat pump duty with internal isolation consisting of rubber vibration isolators and mounting plate with rubber vibration isolators. Compressor motors shall have internal high temperature overload protection.

The outdoor water to refrigerant heat exchanger shall consist of a steel outer jacket with twisted copper inner tube. The indoor brazed plate heat exchangers shall consist of stainless steel plates and nickel or copper brazing. All heat exchangers shall be designed and certified for 600 psig [4136 kPa] working pressure on the refrigerant side and 450 psig [3108 kPa] on the water side. Heat exchangers headered together in parallel shall use a reverse-return or symmetrical arrangement on the water side and symmetrical arrangement on the refrigerant side to ensure even flow splitting. Heat exchangers shall be insulated over all of their outside surface with minimum 3/8" thick closed cell insulation. Insulation consisting of 1/8" closed-cell insulating tape shall not be acceptable.

The electronic expansion valves shall be of stepper-motor rather than pulsing type, and shall provide proper superheat control over the unit's operating range with minimal deviation from superheat setpoint. Superheat shall be determined through the suction pressure-temperature method. Externally mounted pressure controlled water regulating flow valves or thermostatic expansion valves (TXV's) in place of electronic expansion valves are not acceptable.

The suction accumulator shall be insulated with minimum 3/8" thick closed cell insulation to prevent condensation. The accumulator's internal oil return port shall be sized properly for the unit's operating range. To ensure proper oil return, suction accumulator shall not be 'oversized'.

## **Piping and Connections**

The unit shall have one set of primary water in and water out connections. The primary connection type shall be 1" nominal female National Pipe Thread (NPT). All water connectors shall be rigidly mounted to cabinet with corrosion resistant fasteners to prevent relative movement. All water connectors shall be constructed of copper or brass material for corrosion resistance.

All internal water and refrigerant piping shall be insulated with minimum 3/8" thick closed cell insulation. Insulation consisting of 1/8" closed-cell insulating tape shall not be acceptable.

## **Electrical**

Controls and safety devices shall be factory wired and mounted within the unit. Controls shall include 24 volt alternating current (24VAC) activated compressor contactors, and 24VAC 100VA transformer with built in circuit breaker or fused on both primary and secondary sides. A terminal strip with screw in terminals shall be provided for field control wiring. Units shall be name-plated for use with time delay fuses or circuit breakers. Unit controls shall be 24VAC and provide heating as required by the remote thermostat or controller, or on-board controller. Unit shall provide remote fault indication to the control system via serial communications as well as provide fault messages on the front panel LCD display.

## **Unit Control**

The control system shall have the following features:

1. Anti-short cycle time delay on compressor operation. Time delay shall be a minimum of 5 minutes, for both thermostat demand and safety control reset starts. An override shall be provided to disable this delay for unit commissioning and testing purposes.
2. Random compressor start delay of 0-120 seconds on unit power up to facilitate starting multiple units after a power failure.
3. Compressor shutdown for high or low refrigerant pressures, Loss of Charge (LOC), optional low flow conditions, and for optional phase protection faults on three phase models.
4. Automatic intelligent reset: unit shall automatically restart after a trip short cycle delay expires if after trip if the fault has cleared. Should a fault reoccur 3 times sequentially then permanent lockout shall occur, requiring cycling of the power to the unit in order to reset.
5. Manual reset high pressure in case of electronic board failure.
6. The low pressure shall not be monitored for the first 90 seconds after a compressor start to prevent nuisance safety trips.
7. 2 x 16 backlit Liquid Crystal Display (LCD) and four buttons provide basic configuration and data access . Unit may be configured for stand alone operation.
8. Universal Serial Bus (USB) port for full data access and diagnostic information, including manual override of all inputs and outputs, data-logging and real-time charting.

Maritime Geothermal works continually to improve its products. As a result, the design and specifications of any product may be changed without notice. Please contact Maritime Geothermal at 1-506-756-8135 or visit [www.nordicghp.com](http://www.nordicghp.com) for latest design and specifications. Purchaser's approval of this data set signifies that the equipment is acceptable under the provisions of the job specification. Statements and other information contained herein are not express warranties and do not form the basis of any commercial contract or other agreement between any parties, but are merely Maritime Geothermal's statement of opinion regarding its products.

# LIMITED WARRANTY

MARITIME GEOTHERMAL LTD. warrants that its commercial geothermal heat pumps shall be free from defects in materials and workmanship for a period of ONE (1) YEAR after the date of installation or for a period of ONE (1) YEAR AND SIXTY (60) DAYS after the date of shipment, whichever occurs first. This warranty covers all internal components of the heat pump.

MARITIME GEOTHERMAL LTD. shall, at its option, repair or replace any part covered by this warranty. Defective parts shall be returned to MARITIME GEOTHERMAL LTD., transportation charges prepaid. Replacement or repaired parts and components are warranted only for the remaining portion of the original warranty period.

**This warranty is subject to the following conditions:**

1. The geothermal heat pump must be properly installed and maintained in accordance with MARITIME GEOTHERMAL LTD. guidelines.
2. The installer must complete the **Startup Record** and return it to MARITIME GEOTHERMAL LTD. within 21 days of unit installation.
3. For new construction, it is the responsibility of the building or general contractor to supply temporary heat to the structure prior to occupancy. Geothermal heat pumps are designed to provide heat only to the completely finished and insulated structure. Startup of the unit shall not be scheduled prior to completion of construction and final duct installation for validation of this warranty.
4. It is the customer's responsibility to supply the proper quantity and quality of water or properly sized ground loop with adequate freeze protection.

If a geothermal heat pump manufactured by MARITIME GEOTHERMAL LTD. fails to conform to this warranty, MARITIME GEOTHERMAL LTD.'s sole and exclusive liability shall be, at its option, to repair or replace any part or component which is returned by the customer during the applicable warranty period set forth above, provided that (1) MARITIME GEOTHERMAL LTD. is promptly notified in writing upon discovery by the customer that such part or component fails to conform to this warranty; (2) the customer returns such part or component to MARITIME GEOTHERMAL LTD., transportation charges prepaid, within (30) thirty days of failure, and (3) MARITIME GEOTHERMAL LTD.'s examination of such component discloses to its satisfaction that such part or component fails to conform to this warranty and the alleged defects were not caused by accident, misuse, neglect, alteration, improper installation, repair or improper testing. MARITIME GEOTHERMAL LTD. will not be responsible for any consequential damages or labour costs incurred. In addition, MARITIME GEOTHERMAL LTD. will not be responsible for the cost of replacement parts purchased from a third party.